

X-Series Alarm Scan App

Data download app for the X-Series
CO, smoke and heat alarms

Professional Home Safety Experience

Honeywell's X-Series Alarm Scan App enables users of any X-Series alarm to download data from the alarm to a smart device, allowing on-the-spot incident investigation and effortless report generation.

Everything you need to know about what's going on with your CO, smoke and heat alarms is one tap away

The Honeywell X-Series Alarm Scan App allows you to transfer logged Alarm and Fault events, as well as the general device status from all enabled X-Series Alarms to your iOS or Android smart device.

The app is designed for professional landlords, gas engineers, plumbers and other service providers responsible for ensuring the safety of tenants or carrying out initial installations of X-Series alarms. It helps with annual maintenance checks or boiler servicing and provides an easy way to confirm incident reports. Installers or landlords can demonstrate compliance or offer an added-value service that can help build their reputation as a professional and reliable service provider.

If you have an X-Series device in your home and you are interested in seeing more in-depth information about the state of your alarm, the app is the perfect tool to set you free from your safety concerns and gain peace of mind that everything is under control.

How it works

Simply download the app to your Apple® or Android® smart device and activate the data transmission on any X-Series Alarm marked with the Alarm Scan logo by pressing the device button three times.

Within seconds, a device report will be generated. You can decide to transfer data from more devices in the premise and combine the device reports into a Service Report. The Service Report can be shared by email or saved directly on cloud spaces like OneDrive®.



Scan this QR code to watch a video to help you get started with the app. Alternatively, access the video here: homesafety.honeywell.com/alarm+scan



FEATURES & BENEFITS



Quiet data transmission



Wireless transfer without need of additional hardware



Full service report functionality
– saves time with documentation of service inspections



Easy way to demonstrate compliance



Facilitates investigation of CO or fire incidents



Works with all standard X-Series alarms marked with the Alarm Scan logo, including optionally installed wireless modules
– no premium models required



Service history allows you to see all previously completed services



Manually input additional device information and comments, if needed



Option to provide combined reports from multiple devices on the premises



Access insights and recommendations regarding the status of the alarm



Option to search, delete and share service reports via email, OneDrive® and more.



Choose from three options to enter service location: auto-fill using GPS, manually entered or remembered from previous service

X-Series Alarm Scan App Technical Specifications

GENERAL FUNCTIONALITY

- Quiet data transmission
- Detailed information with recommended actions for each Device Report event
- **Service Report:**
 - GPS based address information for Service Report
 - PDF shareable via email or other apps like OneDrive® cloud services
 - Free text search of previously completed Service Reports, e.g. by address
 - Recommended actions for each Service Report
- **Smart App:**
 - Automated allocation of device room and name of previously scanned devices
 - GPS based address information for Service Report

ALARM DEVICE & WIRELESS MODULE INFORMATION

- Model name and picture
- Remaining lifetime
- Removals from mounting plate
- Device tests
- Manufacturing date
- Serial number

ADDITIONAL DEVICE INFORMATION (MANUALLY ENTERED)

- **Installed in correct location:** Yes / No
- **Clear of furniture:** Yes / No
- **Audio played during alarm test:** Yes / No
- **In good condition:** Yes / No
- **Device needs to be replaced:** Yes / No
- **Additional comments**



FAULT & ALARM EVENTS

- **Peak CO concentration during last CO alarm**
- **Last occurrence and overall quantity of:**
 - **CO Alarms grouped by CO concentration:** High (>300ppm) / Medium (>100ppm) / Low (<100ppm)
 - **Pre-Alarms**
 - **Fire Alarms**
- **Background CO:** Accumulated hours of CO concentration >20ppm in the last 12 months
- **Battery Status:** OK / less than 1 year remaining / Fault
- **Device Status:** Ok / Fault
- **End of Life Status:** Ok / Fault
- **Remote Fault:** Ok / Fault
- **Smoke alarm dust level:** Ok / Medium / Fault

SYSTEM REQUIREMENTS

- Smart Device (Phone or Tablet)
- **iOS 8.1 or higher**
- **Android 4.4 or higher**
- **For an optimal user experience we recommend the following devices:**
 - **iOS:** iPhone 5 or newer. iPad 4 or newer
 - **Android:** Samsung S5 or newer. Samsung Tab A.

Example for CO Alarm event detail screen:

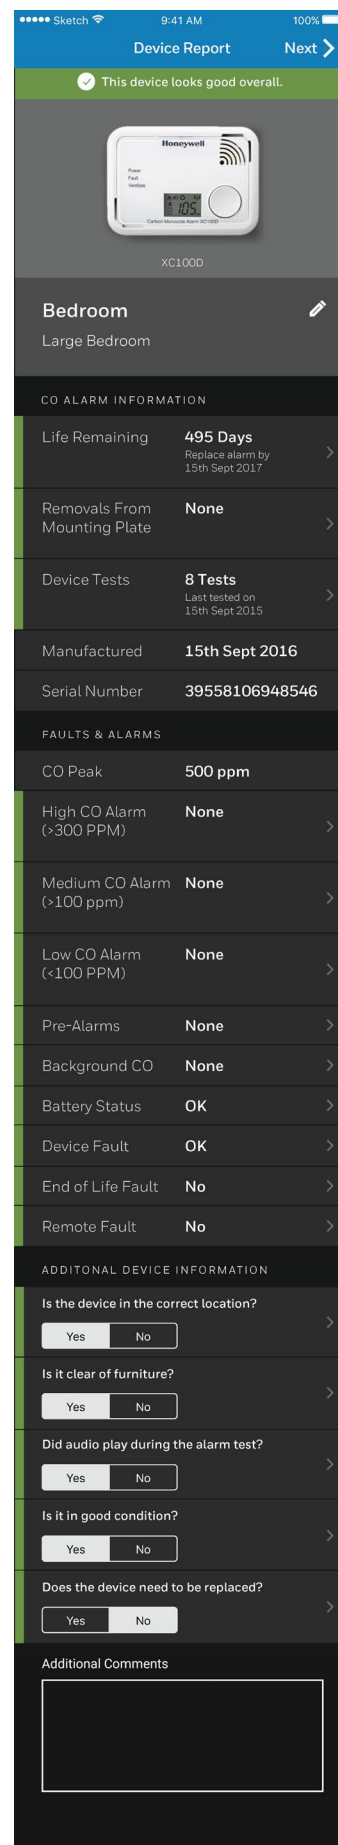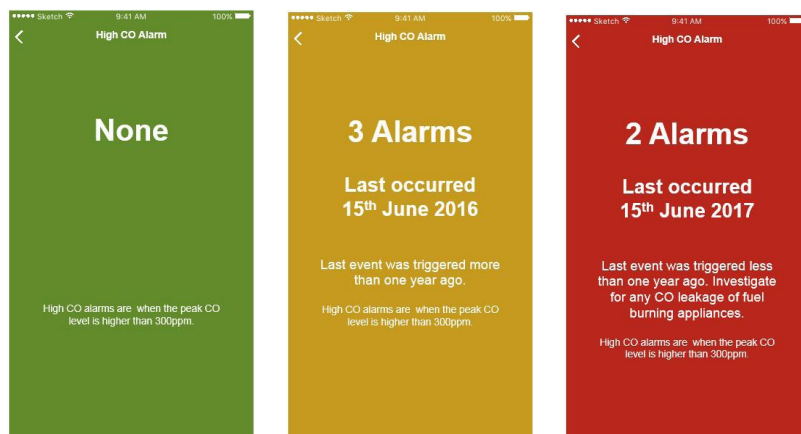

Generate and share reports instantly: PDF service report

Service summary

The report provides an overview of the alarms installed and monitored at a specific address. This overview includes information about the model of each alarm, its position inside the premises and operating status, together with any comments that may have been entered manually.

Honeywell | Professional Home Safety






homesafety.honeywell.com

Apartment #1
1234 Douglas Drive N. Minneapolis 55435
Monday 19th February 2016

Fire Alarm Inspection & Co Ltd
info@firealarm-inspection.com
High Street 5, London, C34 C24


Mr. Smith
+44 999 999 999

ALARM DEVICE SUMMARY


	Bedroom Large Bedroom	Something may be wrong with this device.
	Hallway Downstairs	This device is doing well overall.
	Bedroom	This device needs to be replaced.
	Hallway Upstairs	This device is doing well overall.
	Bedroom Small Bedroom	This device is doing well overall.
Additional Comments		'The dust in the device was cleaned out with a vacuum cleaner.'

Device details

For each alarm, detailed information about its status, historical alarm and fault events, and recommended actions are provided. The same information is also available directly on your smart device.

 | Professional Home Safety

homesafety.honeywell.com



This device is doing well overall.


Bedroom

SMOKE ALARM INFORMATION

Life Remaining	294 Days <small>Replaced on 15th Sept 2016</small>	The remaining life of this device is less than 1 year. Consider replacing the device now.
Removals from Mounting Plate	1 Removal <small>Replaced on 15th Sept 2016</small>	Device has been removed from the mounting plate at least once in the last 12 months, consider investigation.
Device Tests	3 Tests <small>Completed on 1st July 2016</small>	The device was tested within the past 30 days.
Manufactured	15th February 2007	
Serial Number	6834095	

FAULTS & ALARMS

Fire Alarms	2 Alarms <small>Completed on 17th June 2014</small>	Last Fire Alarm was more than 1 year ago.
Dust Level	OK	The smoke chamber is clear enough.
Remote Fault	Fault	Another interconnected unit is in fault.
Battery Status	OK	Battery life is greater than 1 year.



WIRELESS MODULE INFORMATION

Life Remaining	294 Days <small>Replaced on 15th Sept 2016</small>	The remaining life of this device is less than 1 year. Consider replacing the device now.
Network Tests	3 Tests <small>Completed on 1st July 2016</small>	The device was tested within the past 30 days.
Battery Voltage	OK	Battery life is greater than 1 year.
Manufactured	3rd Feb 2007	
Serial Number	1234567	

ADDITIONAL DEVICE INFORMATION

Is the device in the correct location?	Yes	Recommended installation locations can be found on page 10 of the user manual.
Is it clear of furniture?	Yes	Alarm devices should not be blocked by furniture, e.g. in a recommended alarm device location.
Are the smoke holes clear?	Yes	Smoke alarms use an optical sensor to detect fire. This sensor is located on the front panel behind the alarm plate. Ensure that this is kept clear of the alarm plate.
Did audio play during the alarm test?	Yes	Pressing the test button will trigger the alarm system. Please ensure you can hear the alarm. The alarm will only sound when the alarm is tested.
Is it good condition?	Yes	Inspect the alarm device for any damage which hampers its functionality.
Does the device need to be replaced?	No	The alarm device should be replaced once the replacement date printed on the alarm has passed or 10 years of its purchase date. Check the alarm's test button on www.homesafety.honeywell.com

Additional Comments

DOWNLOAD THE APP

Scan the QR code with your smart device and you will be redirected to the corresponding app store where you will be able to download the X-Series Alarm Scan app.



Alarm Scan

Professional Home Safety

Find out more:

www.homesafety.honeywell.com
www.honeywellanalytics.com

Please Note:
While every effort has been made to ensure accuracy in this publication, no responsibility can be accepted for errors or omissions. Data may change, as well as legislation, and you are strongly advised to obtain copies of the most recently issued regulations, standards, and guidelines. This publication is not intended to form the basis of a contract.

DS01184 | Rev 01 | 10/17
© 2017 Honeywell Analytics

